SCG PLATFORM RELEASE NOTES

Release r134

New features and changed features

- In notifications the location and date format are based on the preference of the user. There is a region preference page where you can change the location to feet and format of the date.

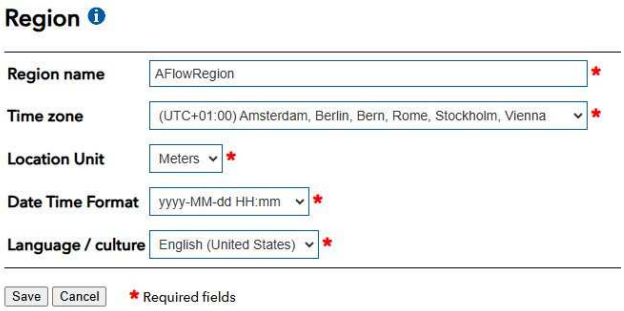

- The PD sensitivity calculation is updated to support the upcoming hardware SCG 3.

Fixes

- User interface fixes:
    - 560310: Filtering on the circuit list is not fully working.
    - 553087: Language selection was not correctly implemented and not all forms on the SCG portal were shown in the selected/preferred language of the user.
    - 600020: Tooltips on the component chart did not always work. On some occasions the tooltip did not fit in the available room and due to this the tooltip did not show.

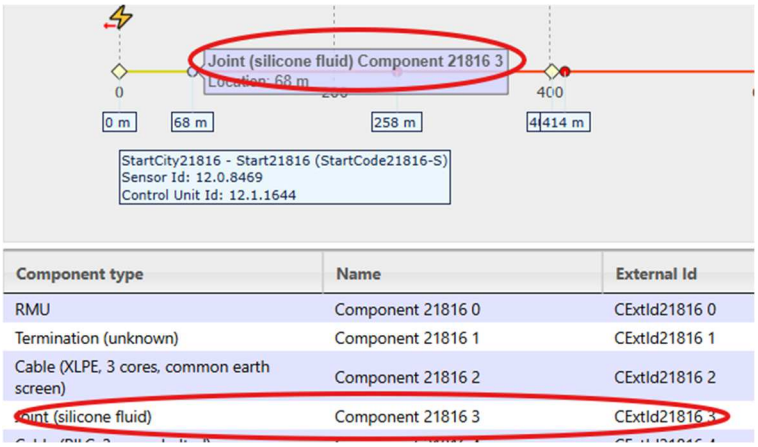

    - 601321: The contact Information in SMS Notifications was displayed incorrectly. The SMS/Text message shows text looking like an e-mail address, it was intended to point to the SCG portal. We corrected the formatting.



- 601493: The fault email for 'fault inside circuit' is having a different font (type and size) than the fault email for 'fault outside circuit'. We corrected the formatting.
- 601505: We removed some unnecessary, duplicated visual elements on sync portal.
- 601532: The fault outside tooltip is lacking the '>' or '<' sign.
- 613120: The restart link on the Circuit pages was misaligned. We corrected that.
- 613432/613433: We have added the navigation bar to all pages in the SCG portal. This will make navigation more consistent throughout the SCG portal.



- 616930: The tooltip on the circuit detail page contained the external id, this was not supposed to be there. We corrected it.

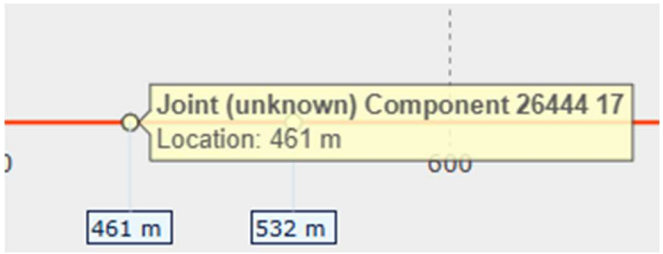

- 619752: Replace fault checkmark image in the SCG Portal to match operational warnings one.
- 621686: 478274: On the Circuit list page we displayed doubled entries while filtering on the Region. We streamlined this, when selecting a region as an admin you will see all customers using this region.

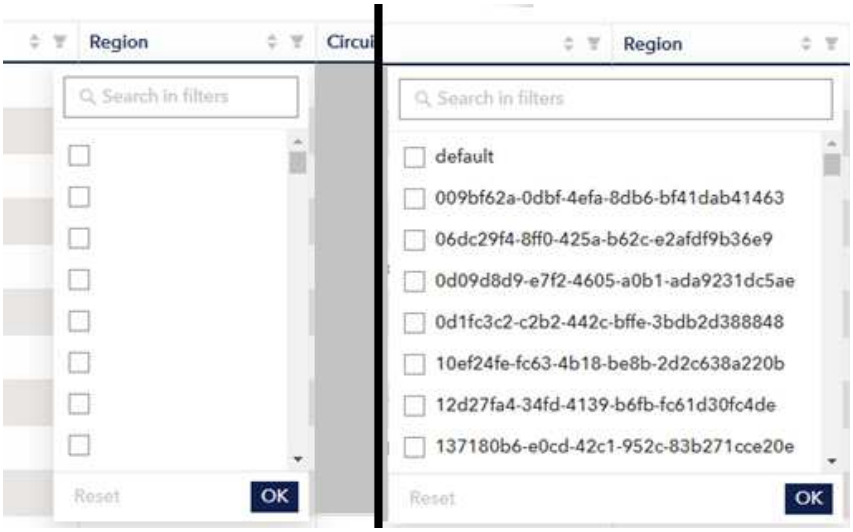

- 625304: The header and footer are made consistent throughout the entire SCG Portal.



- 626965: We renamed Master-Slave to Primary-Secondary (for now only on visible locations/pages, we have not changed the parameters of the APIs yet).

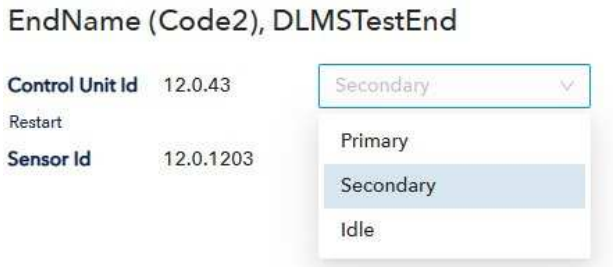

- 627290: On the Circuit details pages the buttons were accidental moved and we put them back to the original location on the screen.

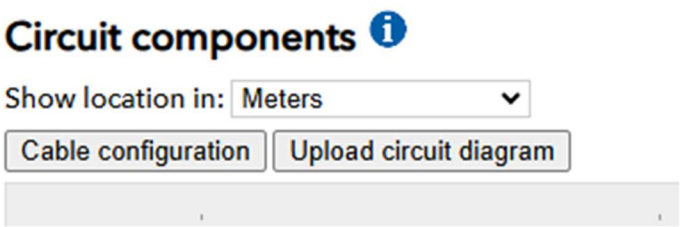

- Fixes with the Operational Warnings:
  - 600011: The 'Since (days)' on some operational warnings was not correct. We changed the logic so this problem will not occur in the future. We corrected the days on the historical operational warnings.

  - 608213: There was an issue with a circuit. The circuit was still active and still having operational warning, but the measurement session was closed. We corrected the logic to prevent this from happening in the future.

- Fixes in SCG API:
  - 402776: The Operational Warning endpoint response contained some duplications.
  - 452099: API endpoint gave an improper response, when the caller didn't have the correct authorization.
  - 607714: First Line Support API is using the wrong naming convention. API was in the URI.
  - 620853: We corrected a performance issue with the fault download service.
  - 622076: In previous releases we added a new version of the APIs. We removed the old API-versions, there is now one version of APIs.
  - 624853: The download data API is failing, when a circuit name contained special characters.
  - 628172: The Get SCG Warnings data endpoint returned incorrect meters.
- Various security related issues
- Various efficiency improvements