SCG PLATFORM RELEASE NOTES

Release r140

New features and changed features

- 730620 [SCG Portal] Extra info PD detection sensitivity
    - The synchronization details page now displays the PD detection sensitivity as an estimated value. Since no PDs are present during synchronization, this estimate may differ from the more accurate value shown later in the PD Chart, which has caused user confusion.
    - To address this, the informational tooltip has been expanded to clearly explain the limitations. The updated tooltip text is:

      “Maximum allowed: xxx pC. Note: this value is a rough estimate.”

    - This information icon (“i”) is displayed in two locations on the form: on both the left and right sides.

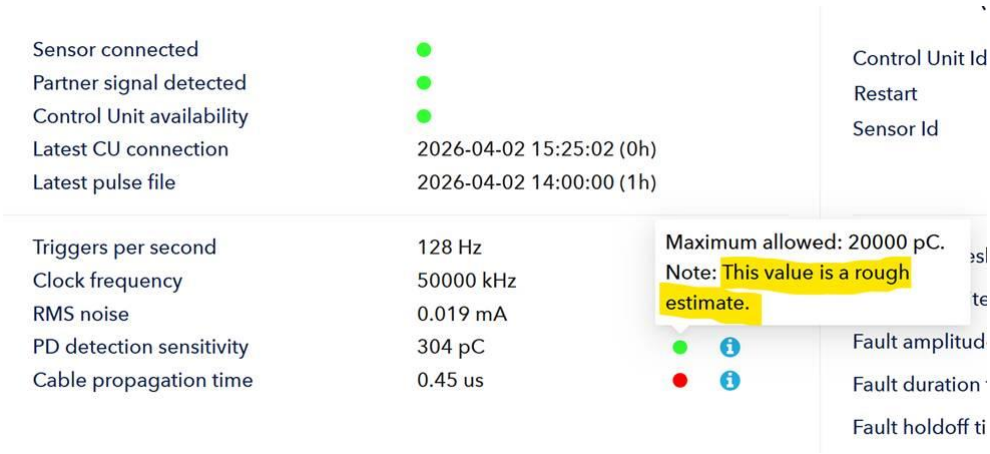

- 728718 [SCG Portal] Monitoring quality warnings history format change on the circuit details page
    - The design of the Monitoring quality warnings history is now consistent to the other tables on the same circuit detail page.
- 611724 Live view on circuits
    - Live status of SCG circuits can be retrieved via the SCG API and send to a Webhook
    - Live availability of SCG platform by sending dummy message and send result to a Webhook

Bugs

- 726168 Fixes search functionality to correctly handle queries containing square brackets [ ].
- 725115 Improves form clarity by ensuring editable fields in Circuit and Organization edit forms are clearly identifiable by an edit box.

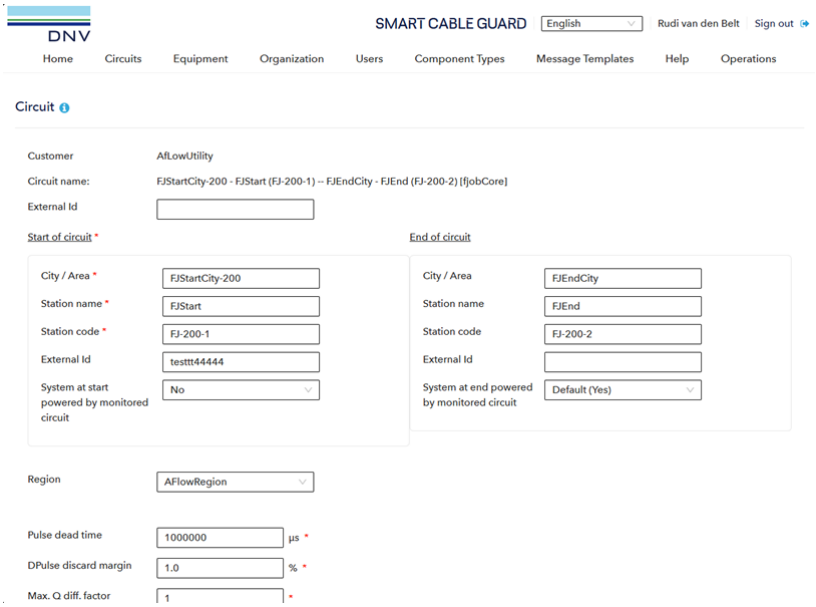

- 712288 – Corrects a problem preventing successful deletion of contacts.
- 688406 – Resolves display and navigation issues in the Circuit List of the Portal.

The selection dropdown for number of item on a page was not available when the number of items was low.

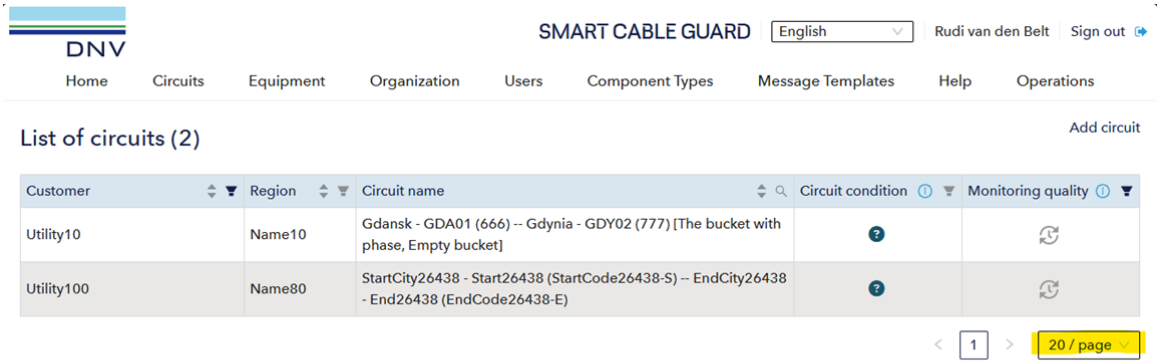

- 646192 – Fixes an issue where the branching icon in CWI was visually disconnected from its associated element.

